

1. DESIGN CRITERIA:
A. DESIGN USING INTERNATIONAL BUILDING CODE, 2018 EDITION
B. ROOF LIVE LOAD/SNOW LOAD = 150 PSF
C. FLOOR LIVE LOAD = 40 PSF
D. FLOOR DEAD LOAD = 12 PSF
E. WIND SPEED = 115 MPH
F. EXPOSURE TYPE = B
G. DESIGN PARAMETERS, 5s = 15
H. MINIMUM PROST DEPTH = 24 INCHES

2. FOUNDATIONS & SLAB ON GRADE:

- A. ALL FOOTING AND FOUNDATION DESIGNS ARE BASED ON AN ALLOWABLE SOIL BEARING CAPACITY OF 1,500 PSF BEARING ON COMPETENT NATIVE SOIL (DOSE MINIMUM). IF THE SITE HAS A LOWER BEARING CAPACITY THAN ASSUMED THE FOUNDATION PLAN WILL NEED TO BE REDESIGNED. IF SOIL IS DISTURBED, COMPACT SOIL IN 4" LIFTS TO 95% MAXIMUM DRY DENSITY PER ASTM D950.
B. MINIMUM PROST DEPTH FROM LOWEST ADJACENT FINISH GRADE TO BOTTOM OF FOOTING SHALL BE MAINTAINED FOR ALL EXTERIOR FOOTINGS.
C. CONTRACTOR TO VERIFY LOCATIONS FOR STEP FOOTINGS AND FOUNDATION WALLS BASED ON SITE RELATED FINISHED GRADE. IF NECESSARY, FOOTING STEPS ARE TO BE A MAXIMUM OF (2) VERTICALLY TO (1) HORIZONTALLY.
D. ALL SLABS SHALL HAVE REINFORCING PER PLANS & CONTROL JOINTS @ 10'-0" SPACING MAX.
E. ALL STRUCTURAL FILL BELOW FOOTINGS SHALL EXTEND OUT PAST FOOTINGS AT A SLOPE OF 1 HORIZONTAL TO 2 VERTICAL TO COMPETENT SOILS.
F. PROVIDE ADEQUATE DRAINAGE BEHIND ALL WALLS TO ALLEVATE ANY STANDING WATER.
G. ALL CONCRETE PAD & APRON LOCATIONS TO BE SECURED TO FOUNDATION WITH #4 DOWELS @ 24" O.C. EXTEND EXPOSED SIDES A MINIMUM OF 24" BELOW FINISHED GRADE.
H. MINIMUM CONCRETE SLAB DEPTH IS 4".

3. CONCRETE:

- A. THE MINIMUM COMPRESSIVE STRENGTHS FOR CONCRETE AT 28 DAYS SHALL BE AS FOLLOWS (DESIGNED USING 2,500 PSI):
1. ALL FOOTINGS, FOUNDATIONS, AND STEM WALLS FC = 3,000 PSI
2. SLABS ON GRADE FC = 3,500 PSI
B. MINIMUM CLEAR PROTECTION FOR REINFORCEMENT SHALL BE AS FOLLOWS:
1. PLACED DIRECTLY AGAINST EARTH: 3"
2. FORMED SURFACES: #3 BARS OR SMALLER: 1-1/2"
3. STRUCTURAL SLABS: 1"
C. SAWN CONTROL & CONSTRUCTION JOINTS SHALL BE MADE AS SOON AS POSSIBLE WITHOUT DAMAGE TO THE SURFACE. FILLING OF SAW JOINTS WHERE REQUIRED SHALL BE DELAYED AS LONG AS POSSIBLE TO ALLOW MAXIMUM SHRINKAGE TO OCCUR IN SLABS.
D. ALL EMBEDDED ANCHOR BOLTS SHALL BE A36 OR A307 STEEL W/ 7" MIN. EMBEDMENT. ANCHOR BOLTS TO BE WITHIN 1'-0" OF SILL PLATE ENDS, WITH A MIN. OF TWO PER WALL AND NO CLOSER THAN 6" FROM CONCRETE WALL CORNERS. REFER TO LOG MANUFACTURER'S SPECIFIC BOLT PLAN FOR LOG WALL ANCHORS. DO NOT POUR FOUNDATION WITH OUT LOG MANUFACTURER'S BOLT PLAN.
E. WET SETTING OF REINFORCING BARS IN FOOTINGS AND WALLS IS NOT ALLOWED.
F. BLOCK-OUT ALL STEM WALLS @ ENTRIES AS REQUIRED.
G. CONCRETE FORM WORK TO BE OF ADEQUATE STRENGTH AND BRACED TO PREVENT DEFORMATION.
H. PROTECT ALL CONCRETE FROM FREEZING.
I. ALL LOWER LEVEL AND RETAINING WALLS WHICH HAVE FILL HIGHER THAN AN INTERIOR FLOOR LEVEL SHALL HAVE AN APPROVED WATERPROOFING MEMBRANE APPLIED.
J. PROVIDE ADEQUATE TEMPORARY BRACING OF CONCRETE AND/OR CMU RETAINING WALLS DURING BACKFILL PRIOR TO INSTALLATION OF MAIN FLOOR FRAMING AND BASEMENT CONCRETE SLAB ON GRADES. WALL DESIGN ARE BASED ON TOP OF WALL RESTRAINED BY FINISHED FLOOR SYSTEM AND RESISTING SLIDING BY HAVING BASEMENT CONCRETE SLAB ON GRADE FLOOR INSTALLED.
K. IT IS RECOMMENDED THAT ALL GRADING, EXCAVATION, AND INSTALLATION OF FOUNDATIONS BE PERFORMED UNDER THE SUPERVISION AND TESTING OF A QUALIFIED GEOTECHNICAL CONSULTANT DURING THE CRITICAL STAGES OF CONSTRUCTION.
L. STAIN A TEXTURE OF EXPOSED CONCRETE SURFACES PER OWNER'S DIRECTION.

4. REINFORCING STEEL:

- A. ASTM A615, GRADE 60. BARS TO BE WELDED SHALL BE ASTM A706, GRADE 60.
B. MINIMUM LENGTH OF LAPPED SPLICES SHALL BE 48 TIMES BAR DIAMETER UNLESS NOTED OTHERWISE. STAGGER SPLICES IN WALLS SO THAT NO TWO ADJACENT BARS ARE SPLICED IN THE SAME LOCATION.
C. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185, F.Y. = 75,000 PSI.
D. REINFORCING SHALL BE CONTINUOUS THROUGH ALL COLD JOINTS.
E. PROVIDE CORNER BARS W/ 18" LEGS AT CORNERS AND INTERSECTING WALLS AND FOOTINGS. SIZE AND PLACEMENT TO MATCH HORIZONTAL REINFORCEMENT.
F. PROVIDE #4 HORIZONTALS AT TOP OF WALL, CONT. IN FOOTINGS, AND ABOVE ALL OPENINGS. PROVIDE #4 HORIZONTALS AT ALL INTERSECTING FLOORS AND ROOF LEVELS. BOTTOM OF ALL WINDOWS AND AT 10'-0" O.C. MAXIMUM OR PER PLANS.
G. PROVIDE #4 VERTICALS AT 24" O.C. W/ STANDARD HOOK EXTENDING INTO FOOTING AT EACH SIDE OF WALL OPENINGS AND AT EACH END OF WALLS.
H. PROVIDE FOUNDATION HOLDDOWS AT ALL SHEAR WALL LOCATIONS PER PLAN, IF APPLICABLE.

5. WOOD FRAMING:

- A. STRUCTURAL LUMBER SHALL BE DOUGLAS FIR LARCH (DF-L) #2 OR BETTER.
B. WOOD INSTALLED WITHIN 1" OF CONCRETE OR MASONRY SHALL BE REDWOOD OR PRESSURE TREATED.
C. PROVIDE WET USE ADHESIVES.
D. MAXIMUM LUMBER MOISTURE CONTENTS SHALL BE 15%.
E. ALL FRAMING DETAILS SHALL BE IN ACCORDANCE WITH THE ADOPTED CODE.
F. PROVIDE SOLID BLOCKING BELOW ALL BEARING WALLS AND POSTS. PROVIDE BLOCKING @ 24" O.C. @ JOISTS PARALLEL WITH BEARING WALLS ABOVE.
G. MINIMUM HEADER AT BEARING WALL TO BE 4X6 WITH 4X6 BEARING STUD PLUS KING STUD EACH SIDE. HEADERS WITH LARGER LOADING WILL BE CALLED OUT IN PLANS.
H. BLOCK AND NAIL ALL HORIZONTAL PANEL EDGES AT SHEAR WALLS.
I. ROOF SHEATHING: 1/2" CDX MIN. (32/16) SPAN RATING 100 @ 2' 1/2" O.C. EDGE AND 1/2" O.C. FIELD (U.N.O.)
J. FLOOR SHEATHING: 3/4" CDX MIN. (48/24) SPAN RATING 100 @ 6" O.C. EDGE AND 1/2" O.C. FIELD (U.N.O.)
K. EXT. WALL SHEATHING: 1/2" CDX MIN. (24/0) SPAN RATING ALL SPAN RATINGS TO MEET LOCAL CODES.
L. ORIENTED STRAND BOARD (OSB) WITH THE SAME SPAN RATING MAY BE SUBSTITUTED.
M. ALL EXTERIOR WALLS TO BE 2X6 @ 16" O.C. AND AT INTERIOR NON-LOAD BEARING PARTITIONS TO BE 2X4 @ 16" O.C. STUD WALLS (U.N.O.)
N. 2X DIMENSIONAL STUDS ARE TO BE STANDARD (DF-L) #2 OR BETTER WESTERN WHITE WOODS (WWW).
O. PROVIDE STEEL STRAPS AT PIPES IN STUD WALLS AS REQUIRED BY THE ADOPTED CODE.
P. OVER-FRAMING SHALL BE DONE SUCH THAT VERTICAL LOADS ARE TRANSFERRED TO MAIN STRUCTURE BELOW BY DIRECT BEARING AT SPACING NOT TO EXCEED 24" O.C.
Q. METAL HANGERS AND CONNECTIONS ARE "SIMPSON" AND SHALL BE INSTALLED PER "SIMPSON" RECOMMENDATIONS.
R. ENGINEERED "V" JOISTS TO BE DESIGNED, CERTIFIED, ERECTED, AND BRACED PER MANUFACTURER'S SPECS. ALL REFERENCES ON PLANS ARE FOR TRUS-JOIST. A WETTER/SLURR BUSINESS PRODUCT. USE THESE PRODUCTS OR AN EQUIVALENT APPROVED MANUFACTURER.
S. SHEATHING SHALL BE APA RATED EXPOSURE 1.
T. PROVIDE SHEATHING END JOINTS 1'-0".
U. PROVIDE 1/4" SPACE AT ALL PANEL EDGES FOR EXPANSION.
V. FRAME INTERIOR BEARING WALLS SHORT TO ACCOUNT FOR LOG SETTLING.
W. FRAME INTERIOR POSTS SHORT TO ACCOUNT FOR LOG SETTLING. USE REMOVABLE SHIMS OR SETTING JACK AS NECESSARY.
X. ALL WINDOW SIZES ARE NOMINAL. VERIFY ACTUAL LOG OPENINGS WITH LOG & WINDOW MANUFACTURERS.
Y. ALL MICROLAM LVLS SHALL HAVE THE MINIMUM SECTION PROPERTIES OF FB = 2900 PSI, FV = 285 PSI, E = 2,000,000 PSI.
Z. ALL ROOF OPENINGS GREATER THAN 1'2" X 1'2" SHALL BE FRAMED IN OPENINGS.
AA. GULF LAM BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F-V4 FOR SHARPLY SUPPORTED AND 24F-V6 FOR CANTILEVERED BEAMS. FB = 2400 PSI, FV = 145 PSI, E = 1,600,000 PSI. PROVIDE WET USE GLUE ON ALL EXTERIOR LOCATIONS.

6. STRUCTURAL STEEL:

- A. BOLTS AND LAGS SHALL CONFORM TO ASTM A36 (U.N.O.)
B. STEEL TUBES TO CONFORM TO ASTM500, GRADE B (FY = 48KSI)
C. PROVIDE MILD STEEL PLATE WASHERS AT ALL BOLT HEADS AND NUTS BEARING AGAINST WOOD.
D. ALL WORK SHALL BE IN ACCORDANCE WITH THE 8TH EDITION, OR 1ST EDITION LRFD MANUAL OF ASCE SPECIFICATIONS FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS.
E. ALL WELDING SHALL BE PERFORMED PER AWS D1.1 WITH A MINIMUM WELD SIZE OF 3/16" AND WITH E70XX ELECTRODE.
F. MACHINE BOLTS SHALL BE ASTM A325 (U.N.O.)
G. PROVIDE LOCK WASHERS BETWEEN NUT AND CONNECTED STEEL.
H. ALL STEEL, INCLUDING NUTS, BOLTS, AND WASHERS EXPOSED TO WEATHER, SHALL BE GALVANIZED.

7. PRE-MANUFACTURED METAL PLATED TRUSSES:

- A. PRE-MANUFACTURED TRUSS PROVIDER TO VERIFY ALL LOADING PATTERNS TO FOOTINGS BELOW.
B. PRE-MANUFACTURED TRUSS PROVIDER TO PROVIDE SUPPORT @ TRUSSES FOR LOADING SHOWN ON ALL PLANS, SECTIONS AND DETAILS. VERIFY SECOND FLOOR LOADING AND SPECIAL CASE POINT LOADING FROM LOGS AND FRAMED ROOF SYSTEMS.
C. ALL PRE-MANUFACTURED ROOF TRUSSES SHALL BE DESIGNED FOR THE ROOF LOADS SHOWN AND ACCOUNT FOR ANY REQUIRED ADDITIONAL DRIFT, VALEY, OR EAVE LOAD PER CODE. TRUSS SHOP DRAWINGS SHALL BE SUBMITTED TO THE ENGINEER OF RECORD (E.O.R.) FOR REVIEW AND COMPLIANCE.

8. GENERAL STRUCTURAL NOTES:

- A. CONTRACTOR TO VERIFY ALL OPENINGS, BUILDING DIMENSIONS, COLUMN LOCATIONS AND EMBEDDING WITH OWNER AND LOG MANUFACTURER PRIOR TO POURING OF ANY CONCRETE FOUNDATIONS OR CONSTRUCTION.
B. THE ENGINEER OF RECORD IS NOT RESPONSIBLE FOR ANY DEVIATIONS FROM THESE PLANS UNLESS SUCH CHANGES ARE AUTHORIZED IN WRITING TO THE ENGINEER OF RECORD.
C. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING SAFE AND ADEQUATE SHORING AND/OR TEMPORARY STRUCTURAL STABILITY FOR ALL PARTS OF THE STRUCTURE DURING CONSTRUCTION. THE STRUCTURE SHOWN ON THE DRAWINGS HAS BEEN DESIGNED FOR FINAL CONFIGURATION.
D. NOTCHING AND/OR CUTTING OF ANY STRUCTURAL MEMBER IN THE FIELD IS PROHIBITED, UNLESS PRIOR CONSENT IS GIVEN BY THE ENGINEER OF RECORD.

2018 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)						
THE PREPARED BUILDING HAS BEEN DESIGNED TO MEET OR EXCEED THE REQUIREMENTS OF THE INTERNATIONAL ENERGY CONSERVATION CODE						
TABLE 110.1.1.1 (PART 1)				TABLE 110.1.1.1 (PART 2)		
CLIMATE ZONE	CEILING FLOOR AREA	WALLS	ROOF	CEILING FLOOR AREA	WALLS	ROOF
1	10	10	10	10	10	10



MAIN LEVEL	4198	sq. f.
UPPER LEVEL	847	sq. f.
TOTAL LIVING SPACE	5045	sq. f.
UNFINISHED/MECH.	86	sq. f.
GARAGE	1228	sq. f.
COVERED PORCH/DECK	879	sq. f.

PAGE	SHEET INDEX
A1	TITLE
A2	COVER SHEET
A3	SITE PLAN
A4	LANDSCAPE PLAN
A5	FLOOR PLAN - 1ST LEVEL
A6	FLOOR PLAN - 2ND LEVEL
A7	ELEVATIONS
A8	ELEVATIONS

PROJECT NO.
26-006

4 BDRM 5-3/4 BATH
TAMARACK PH 1 LOT 1 VALLEY CO. ID



SHEET SIZE
36" x 48"

INITIAL DATE: 06/15/2026
PRINT DATE: 9/17/2026

DRAWN BY: Steve

SMC Design
208.249.1288
Nampa, ID

SHEET NUMBER
A1
PAGE 1

CONTRACTOR TO VERIFY ALL DETAILS, DIMENSIONS, AND SPECIFICATIONS PRIOR TO CONSTRUCTION, AND REPORT ANY OMISSIONS AND/OR ERRORS TO SMC DESIGN. THE PURCHASER OR BUILDER OF THIS PLAN RELEASES SMC DESIGN FROM ANY CLAIMS, LITIGATIONS OR SUITS THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

COVER SHEET



PROJECT NO.
26-006

4 BDRM 5-3/4 BATH
TAMARACK PH 1 LOT 1 VALLEY CO. ID

SHEET SIZE
36" x 48"

INITIAL DATE: 06/15/2026
PRINT DATE: 9/17/2026

DRAWN BY:
Steve

SMC Design
208.249.1288
Nampa, ID

SHEET NUMBER
A2
PAGE 2

CONTRACTOR TO VERIFY ALL DETAILS, DIMENSIONS, AND SPECIFICATIONS PRIOR TO CONSTRUCTION, AND REPORT ANY OMISSIONS AND/OR ERRORS TO SMC DESIGN. THE PURCHASER OR BUILDER OF THIS PLAN RELEASES SMC DESIGN FROM ANY CLAIMS, LITIGATIONS OR SUITS THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

SITE PLAN

SHEET INDEX	
PAGE	TITLE
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS
A7	ELEVATIONS

COVERAGE:
LOT AREA = 50,965 SF
BUILDING FOOTPRINT = 6,391 SF
DRIVEWAY = 2,315 SF
SIDEWALK = 55 SF


ALLOWABLE COVERAGE (PER LOT EXHIBIT) = 13,156 SF
ACTUAL TOTAL COVERAGE = 9,841 SF

ALLOWABLE FOOTPRINT (13% OF LOT AREA) = 6,625 SF
ACTUAL BUILDING FOOTPRINT = 6,391 SF

TAMARACK PH 1 LOT 1
1 IN = 10 FT

PRELIMINARY
NOT FOR CONSTRUCTION

PRELIMINARY
NOT FOR CONSTRUCTION

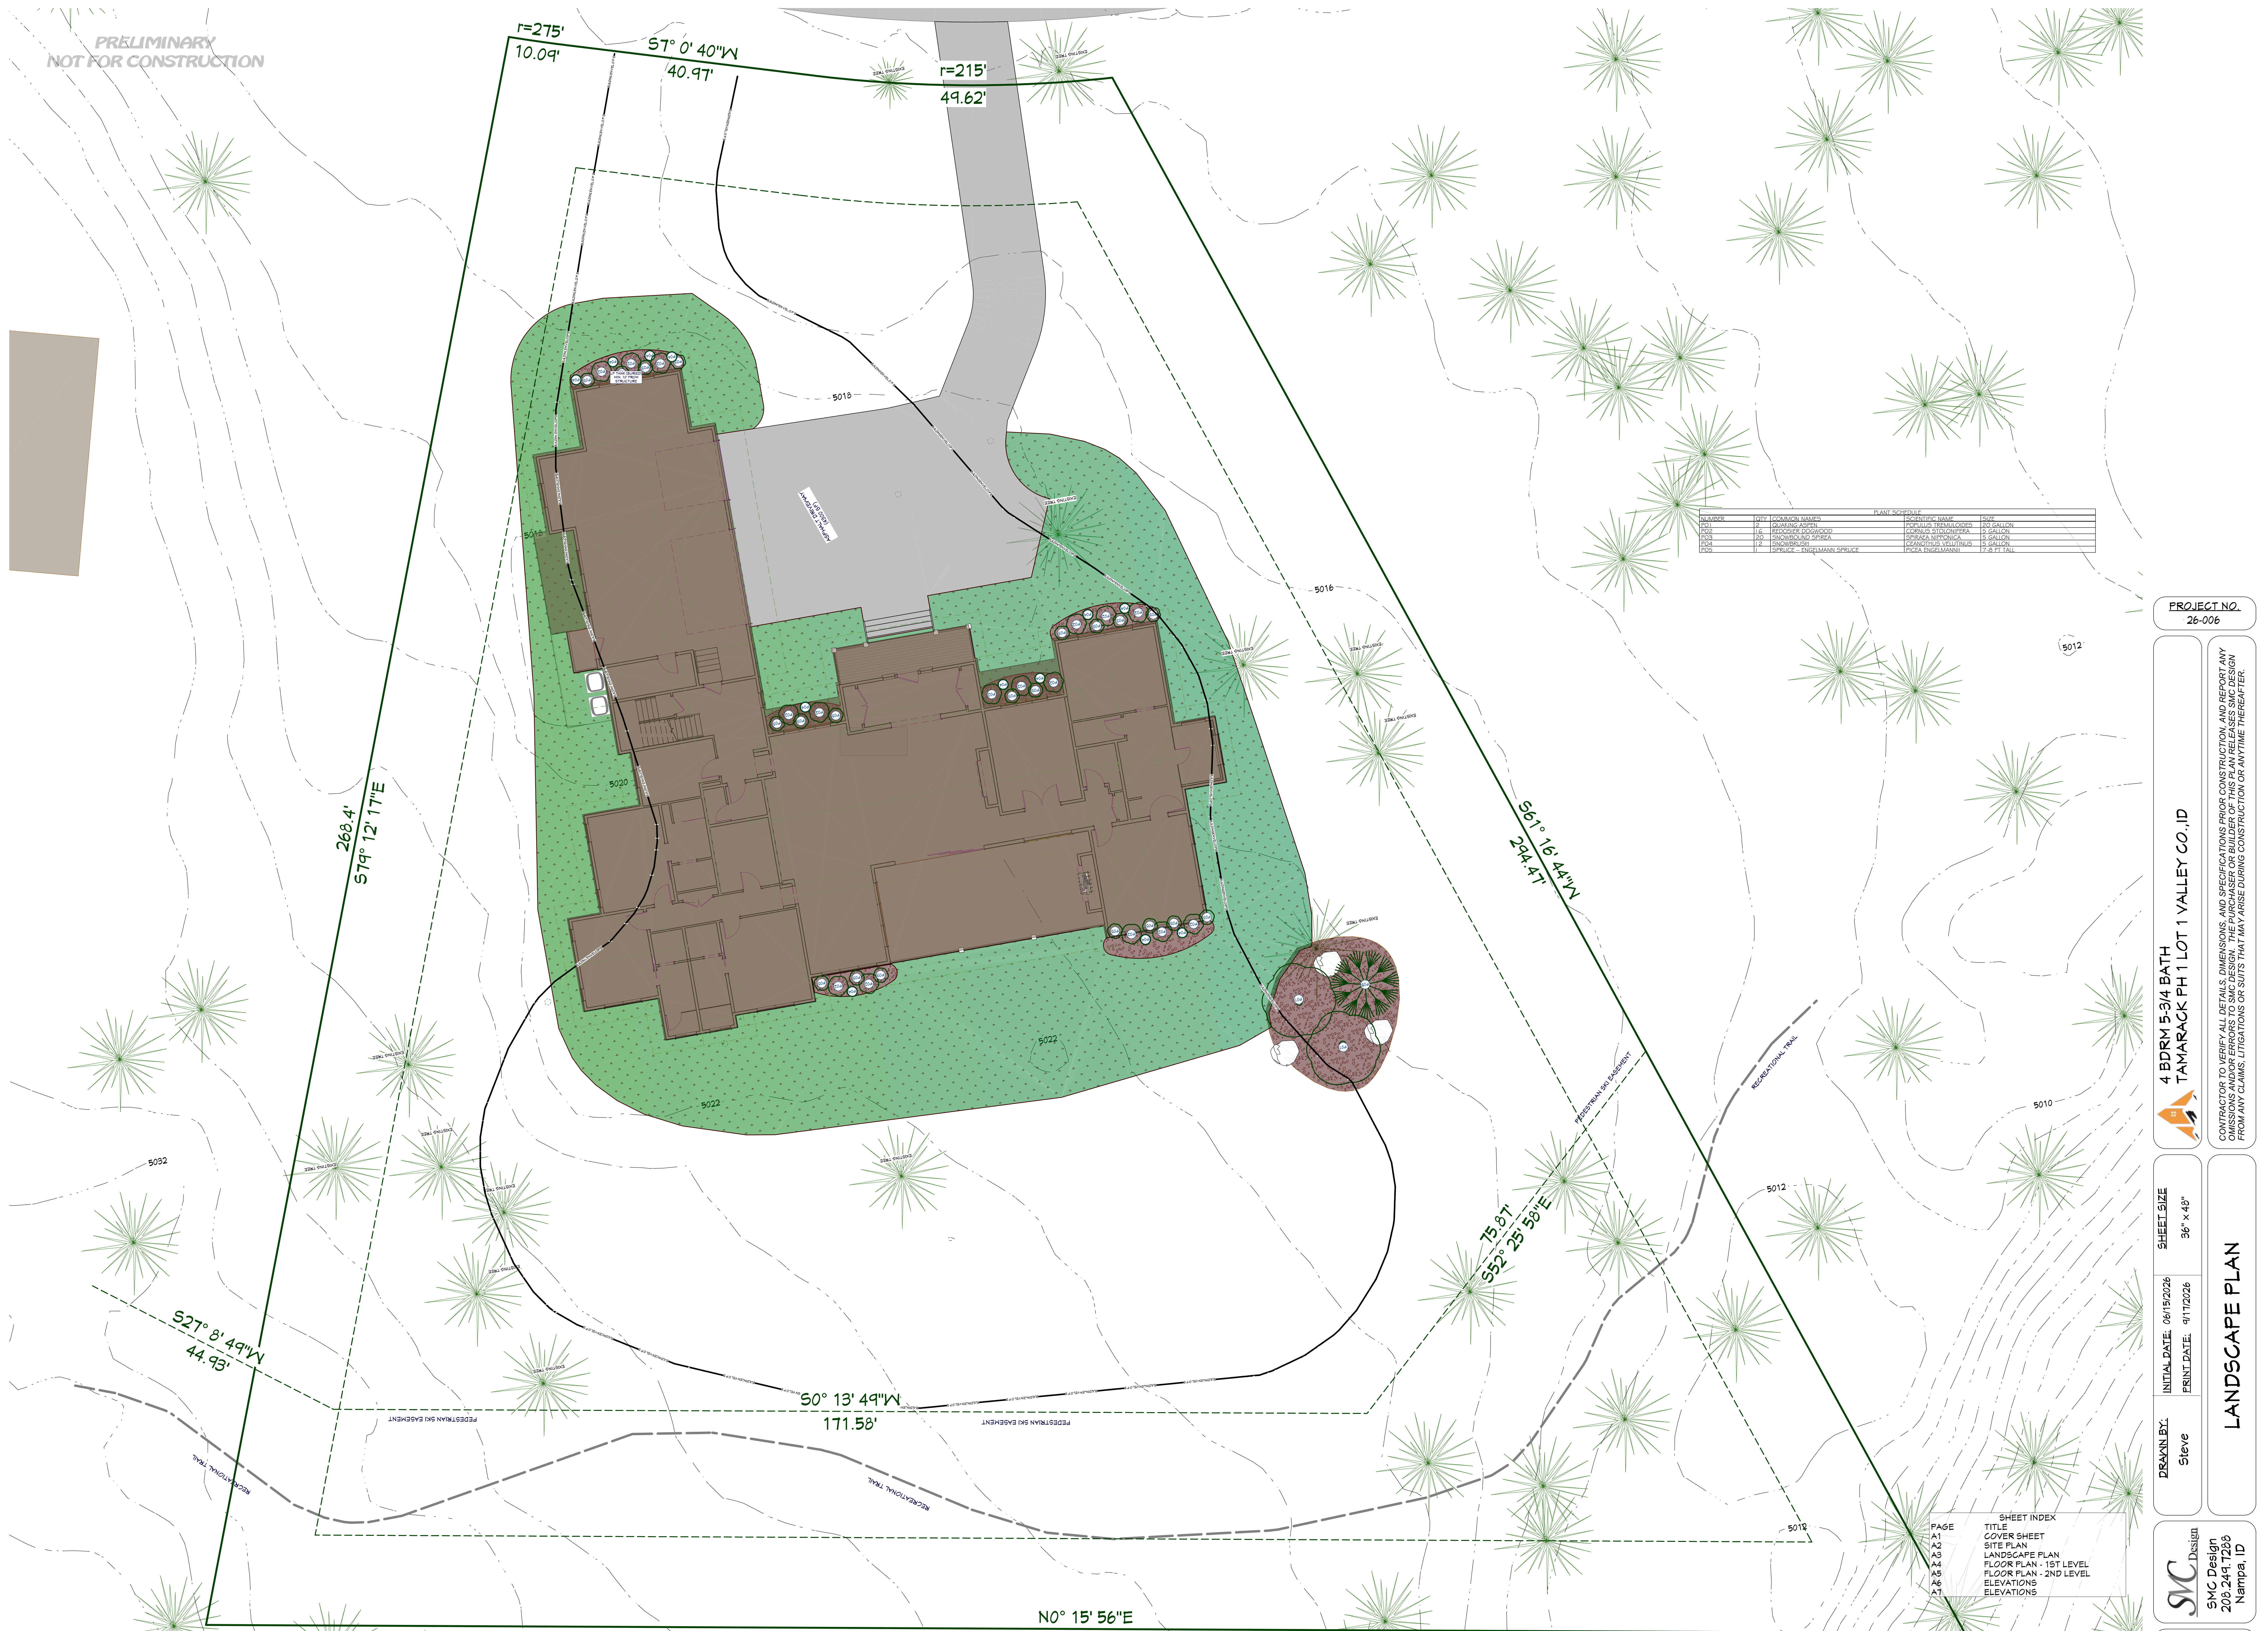

PLANT SCHEDULE			
NUMBER	QTY	COMMON NAME	SCIENTIFIC NAME
PO1	2	QUERCUS ALBA	QUERCUS ALBA
PO2	16	SPARGANGLER DOGWOOD	SPARGANGLER DOGWOOD
PO3	16	SPARGANGLER DOGWOOD	SPARGANGLER DOGWOOD
PO4	2	SPARGANGLER DOGWOOD	SPARGANGLER DOGWOOD
PO5	1	SPARGANGLER DOGWOOD	SPARGANGLER DOGWOOD
PO6	1	SPARGANGLER DOGWOOD	SPARGANGLER DOGWOOD

PROJECT NO.
26-006

4 BDRM 5-3/4 BATH
TAMARACK PH 1 LOT 1 VALLEY CO. ID



CONTRACTOR TO VERIFY ALL DETAILS, DIMENSIONS, AND SPECIFICATIONS PRIOR TO CONSTRUCTION, AND REPORT ANY OMISSIONS AND/OR ERRORS TO SMC DESIGN. THE PURCHASER OR BUILDER OF THIS PLAN RELEASES SMC DESIGN FROM ANY CLAIMS, LITIGATIONS OR SUITS THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

SHEET SIZE
36" x 48"

INITIAL DATE: 06/15/2026
PRINT DATE: 06/17/2026

DRAWN BY:
Steve

SMC Design
208.249.1288
Nampa, ID


SHEET NUMBER
A3
PAGE 3

LANDSCAPE PLAN

SHEET INDEX	
PAGE	TITLE
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS
A7	ELEVATIONS


TAMARACK PH 1 LOT 1
1/8" = 1' FT

PRELIMINARY
NOT FOR CONSTRUCTION

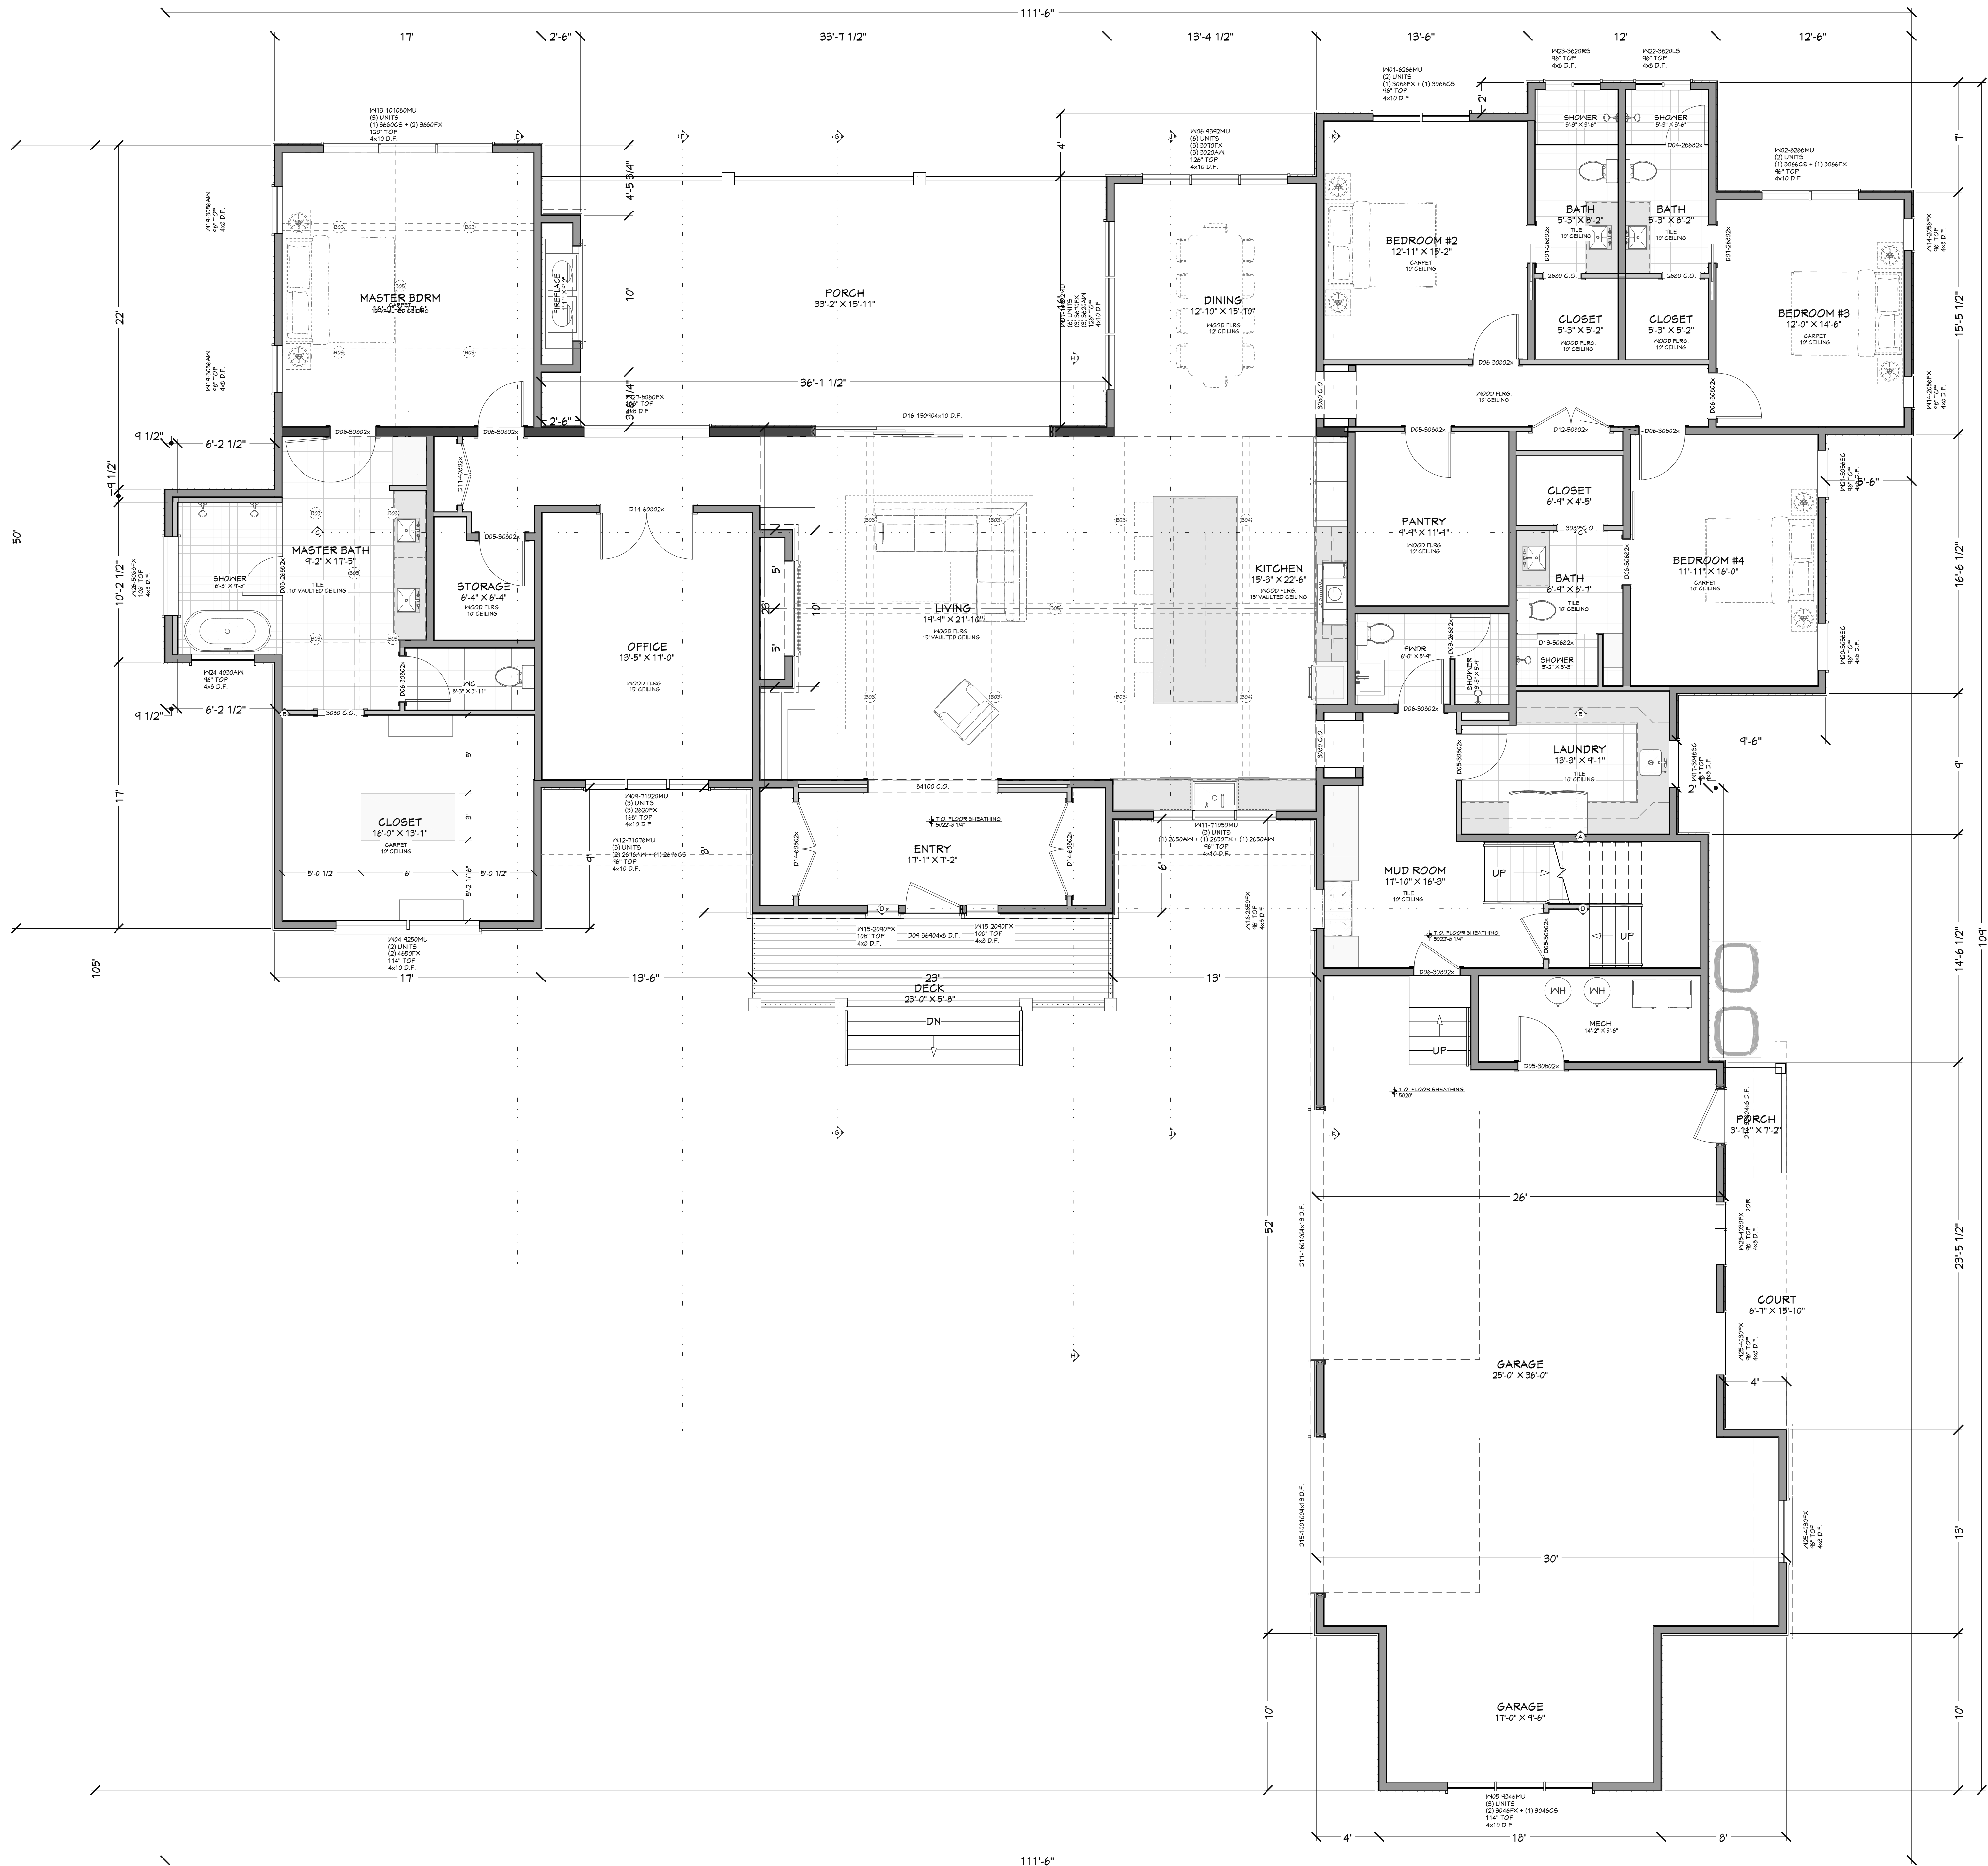

NUMBER	QTY	FLOOR	SIZE	WIDTH	HEIGHT	TYPE	DOOR SCHEDULE	COMMENTS	HEADER	CALC #	NUMBER
D01	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D01
D02	2	2	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D02
D03	2	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D03
D04	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D04
D05	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D05
D06	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D06
D07	2	2	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D07
D08	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D08
D09	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D09
D10	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D10
D11	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D11
D12	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D12
D13	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D13
D14	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D14
D15	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D15
D16	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D16
D17	1	1	3600 S	36"	72"	DOOR	YES		4X10 D.F.		D17

NUMBER	QTY	FLOOR	SIZE	WIDTH	HEIGHT	TYPE	WINDOW SCHEDULE	COMMENTS	HEADER	CALC #	NUMBER
W01	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W01
W02	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W02
W03	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W03
W04	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W04
W05	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W05
W06	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W06
W07	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W07
W08	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W08
W09	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W09
W10	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W10
W11	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W11
W12	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W12
W13	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W13
W14	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W14
W15	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W15
W16	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W16
W17	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W17
W18	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W18
W19	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W19
W20	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W20
W21	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W21
W22	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W22
W23	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W23
W24	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W24
W25	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W25
W26	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W26
W27	1	1	3600 S	36"	72"	WINDOW	YES		4X10 D.F.		W27

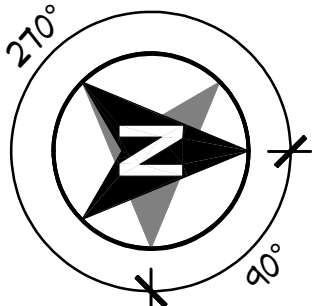


MAIN LEVEL NOTES:
ALL ANGLE 45° UNO
2x6 EXT. WALLS @ 16" O.C.
10'-1 1/8" PLATE HEIGHT UNO
ALL PARTITION DIMENSIONS
ARE TO FACE OF STUD

MAIN LEVEL	4198	sq. ft.
UPPER LEVEL	847	sq. ft.
TOTAL LIVING SPACE	5045	sq. ft.
UNFINISHED/MECH.	86	sq. ft.
GARAGE	1228	sq. ft.
COVD PORCH/DECK	874	sq. ft.


PAGE	TITLE
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS
A7	ELEVATIONS



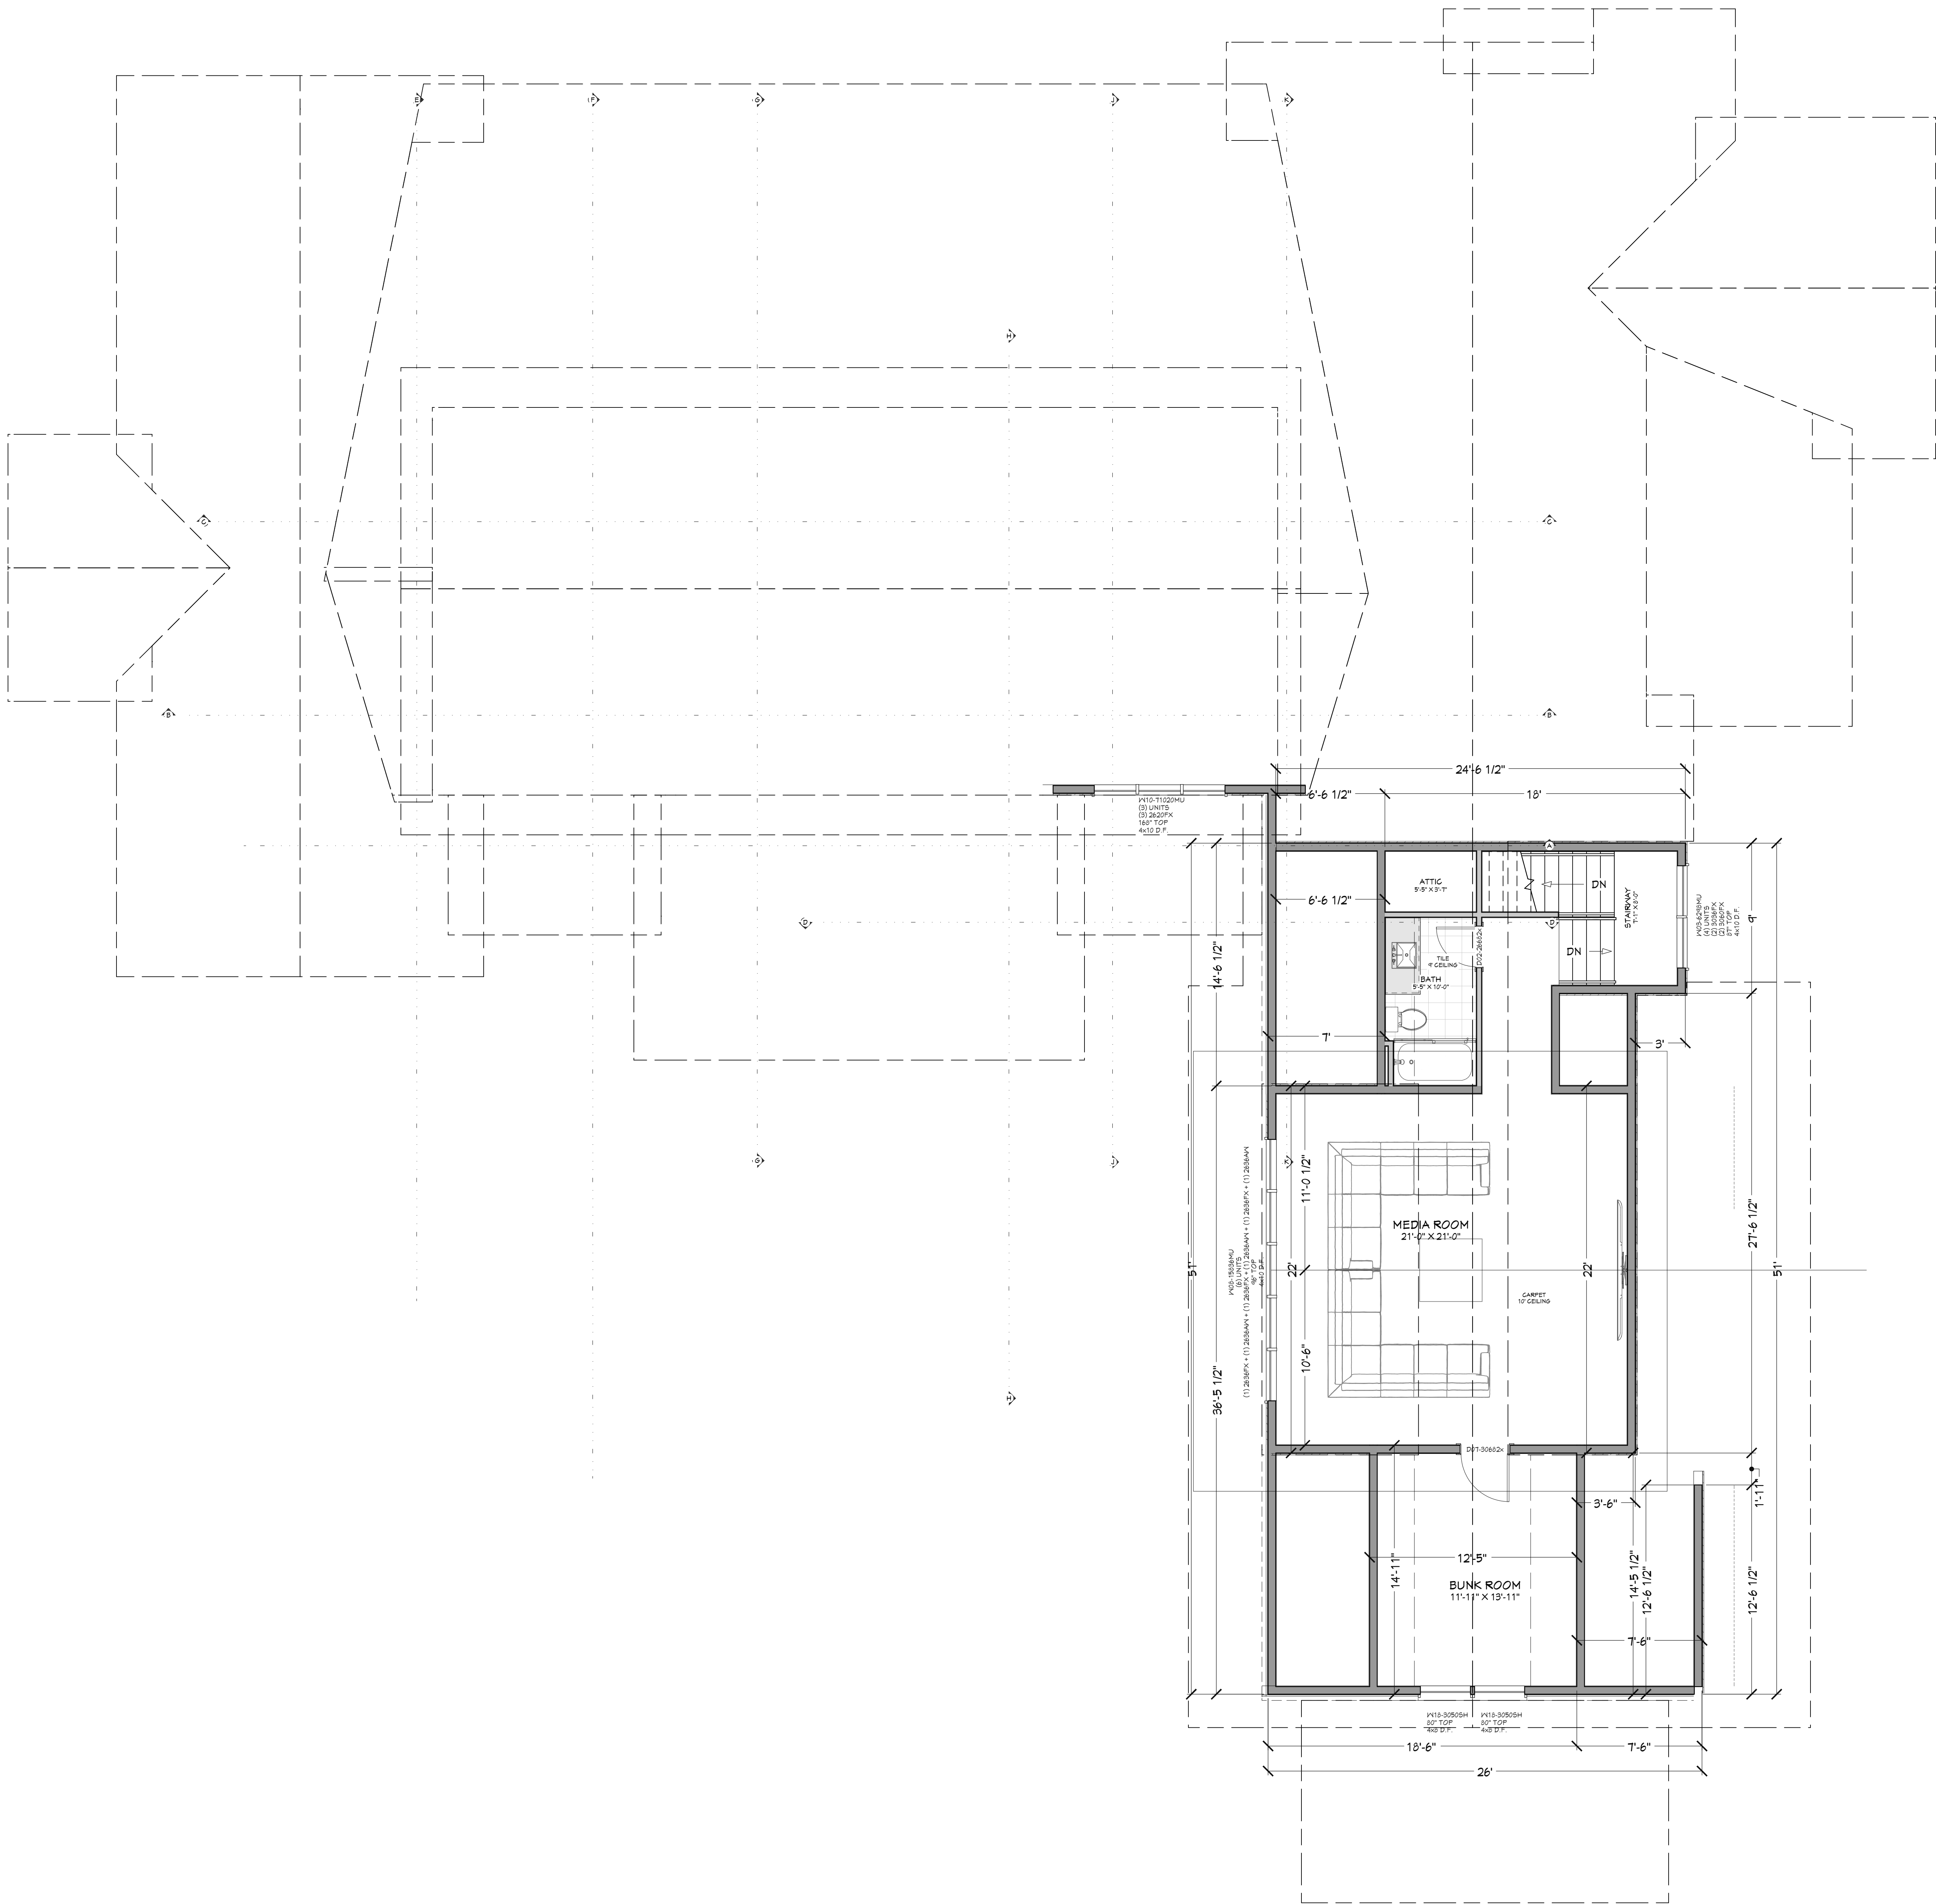

DOOR SCHEDULE										
NUMBER	QTY	FLOOR	SIZE	WIDTH	HEIGHT	TYPE	TEMPERED	FIRE	COMMENTS	HEADER
D01	2	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D02	2	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D03	2	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D04	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D05	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D06	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D07	2	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D08	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D09	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D10	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D11	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D12	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D13	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D14	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D15	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D16	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
D17	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.

WINDOW/DOOR LABEL LEGEND										
NUMBER	QTY	FLOOR	SIZE	WIDTH	HEIGHT	TYPE	TEMPERED	FIRE	COMMENTS	HEADER
W01	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W02	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W03	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W04	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W05	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W06	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W07	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W08	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W09	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W10	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W11	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W12	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W13	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W14	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W15	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W16	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W17	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W18	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W19	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W20	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W21	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W22	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W23	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W24	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W25	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W26	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.
W27	1	1	3600 S	3'-0"	7'-0"	DOOR				4X10 D.F.

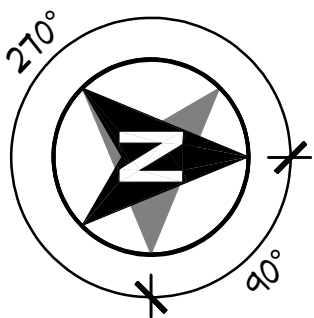

MAIN LEVEL NOTES:
ALL ANGLE 45° UNO
2x6 EXT. WALLS @ 16" O.C.
10'-1 1/8" PLATE HEIGHT UNO
ALL PARTITION DIMENSIONS
ARE TO FACE OF STUD

MAIN LEVEL	4195	sq. ft.
UPPER LEVEL	847	sq. ft.
TOTAL LIVING SPACE	5045	sq. ft.
UNFINISHED/MECH.	86	sq. ft.
GARAGE	1228	sq. ft.
COVD PORCH/DECK	874	sq. ft.


PAGE	TITLE
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS
A7	ELEVATIONS





FT FRONT ELEVATION
1/4 IN = 1 FT

EAVE DETAIL DETAIL

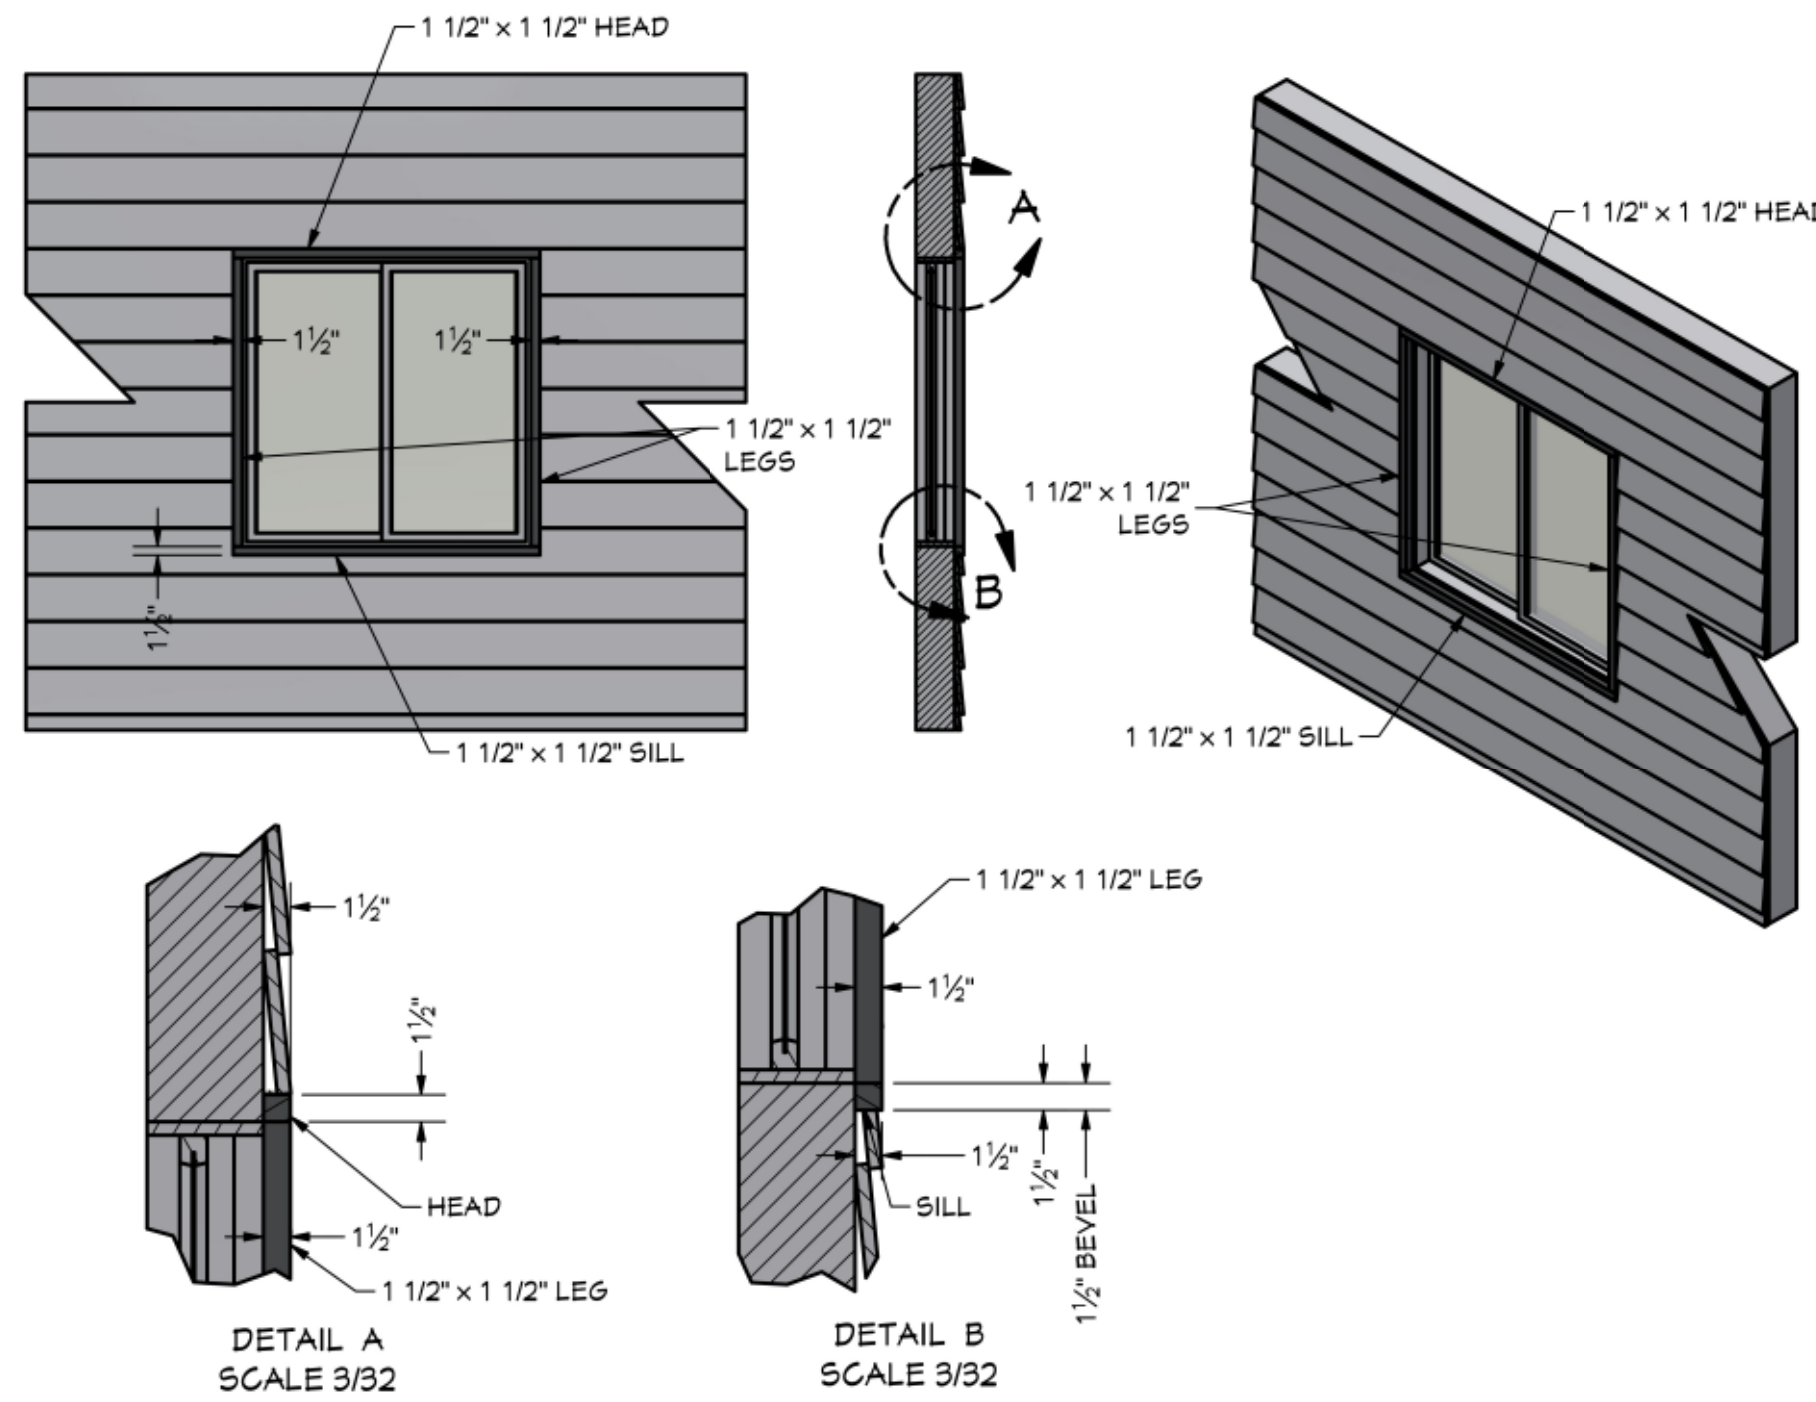

LT LEFT ELEVATION
1/4 IN = 1 FT

PAGE	SHEET INDEX
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS

PROJECT NO.
26-006

4 BDRM 5-3/4 BATH
TAMARACK PH 1 LOT 1 VALLEY CO. ID



SHEET SIZE
36" x 48"

INITIAL DATE: 06/15/2026
PRINT DATE: 9/17/2026

DRAWN BY:
Steve

SMC Design
208.249.1288
Nampa, ID

SHEET NUMBER
A6
PAGE 6

CONTRACTOR TO VERIFY ALL DETAILS, DIMENSIONS, AND SPECIFICATIONS PRIOR TO CONSTRUCTION, AND REPORT ANY OMISSIONS AND/OR ERRORS TO SMC DESIGN. THE PURCHASER OR BUILDER OF THIS PLAN RELEASES SMC DESIGN FROM ANY CLAIMS, LITIGATIONS OR SUITS THAT MAY ARISE DURING CONSTRUCTION OR ANYTIME THEREAFTER.

ELEVATIONS



RE REAR ELEVATION
1/4 IN = 1 FT



RT RIGHT ELEVATION
1/4 IN = 1 FT

PAGE	SHEET INDEX
A1	COVER SHEET
A2	SITE PLAN
A3	LANDSCAPE PLAN
A4	FLOOR PLAN - 1ST LEVEL
A5	FLOOR PLAN - 2ND LEVEL
A6	ELEVATIONS
A7	ELEVATIONS

PROJECT NO.
26-006

4 BDRM 5-3/4 BATH
TAMARACK PH 1 LOT 1 VALLEY CO. ID

SHEET SIZE
36" x 48"

INITIAL DATE: 06/19/2026
PRINT DATE: 9/17/2026

DRAWN BY:
Steve

SMC Design
SMC Design
208.249.1288
Nampa, ID

SHEET NUMBER
A7
PAGE 7